


Clearances to combustible material

- Unit to side wall 18"
- Unit to back wall 24"
- Flue to sidewall 30"
- Flue to backwall 28"

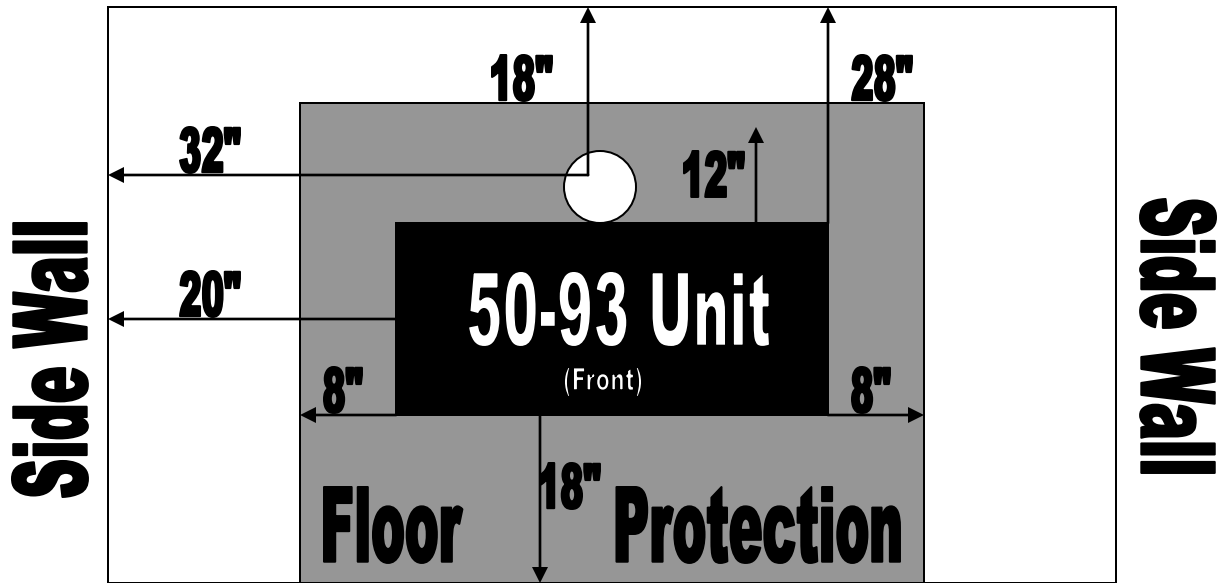

Clearance to Combustibles

- Unit to back wall 28"
- Unit to side wall 20"
- Flue to back wall 18"
- Flue to side wall 32"